CBUCK Engineering

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Evaluation Report

"Solar Attic Fans"
Self-Flashing Series
with Inclined Remote Mounted Solar Panel

Manufacturer

Attic Breeze, LLC.

1370 FM 116

Gatesville, Texas 76528

(877) 288-4234

for

Florida Product Approval

FL 13339.3 R9

Florida Building Code 7th Edition (2021)

Per Rule 61G20-3

Method: 2 - B

Category: Roofing

Sub - Category: Roofing Accessories that are an Integral

Part of the Roofing System

Product: Solar Attic Fans **Product Description:** Self-Flashing Series

with Remote Inclined Mounted Solar Panel
Attachments to Plywood Deck & Rafter

Prepared by:

James L. Buckner, P.E., SECB

Florida Professional Engineer # 31242

Florida Evaluation ANE ID: 1916


Report No. 21-416.03-SPAF-RemInc-S4W-ER

Date: 03 / 30 / 2021

Contents:

Evaluation Report Pages 1 – 8

This item has been electronically signed and sealed by James L. Buckner, P.E., on this date using a Digital Signature. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.



2021.03.30 22:11:49 -04'00'



Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 2 of 8

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Product Name: Solar Attic Fans

Product Category: Roofing

Product Sub-Category Roofing Accessories that are an Integral part of the Roofing System

Compliance Method: State Product Approval Rule 61G20-3.005 (2) (b)

Product Description: The Solar Attic Fans are roof mounted ventilation system powered by one or two

solar panels. The unit consists of a 14 inch diameter fan, enclosed in a self-flashing fan house base vent, with corrosion resistant zincalume alloy steel housing, including a thermal switch, and a rodent guard. Solar panel is remotely mounted from the fan

house unit shroud/dome.

Product Assembly as

Evaluated:

Self-flashing solar attic fan with inclined remote mounted solar panel

- Fan house base unit component mechanically attached to deck with wood

screws

- Solar panel remotely attached to one (1) universal mounting bracket with

machine bolts

- Inclined universal mounting bracket attached through roof deck to roof

rafter/truss top chord with lag screws

Model Numbers: GEN2 GEN3

AB-2022D AB-2523D AB-3022D AB-3523D AB-4022D AB-4523D

Fan Unit Base Support: Type:

Wood Deck

(Design of support system is outside the scope of this evaluation)

Description:

• 15/32" or greater Plywood, or

Wood plank deck (based on minimum density/specific gravity of 0.42)

Solar Panel Support: Roof Rafter/Truss Top Chord

Type: Dimensional Lumber (Designed by Others)

Density/Specific Gravity: 0.42 Minimum Nominal Size: 2 × 4 Minimum

Roof Slope: Slope shall be in compliance with FBC, Chapter 15 based on the type of roof covering.

Performance: Allowable Wind Resistance:

* Positive Design Pressure: + 115 PSF

* Negative Design Pressure: - 115 PSF

* Allowable design pressures for allowable stress design (ASD).

Performance Standards: The following test protocol was performed to demonstrate compliance with the intent of the code as this product is not specifically addressed in the performance



Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 3 of 8

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

standards listed in the code.

ASTM E330-02 — Standard Test Method for Structural Performance of Exterior Windows, Curtain Walls, and Doors and by Uniform Static Air Pressure Difference

Code Compliance:

The product described herein has demonstrated compliance with the Florida Building Code 7th Edition (2020), Section 1708.2.

Evaluation Report Scope:

This product evaluation demonstrates compliance of this product with the structural wind load requirements of the Florida Building Code 7th Edition (2020), as related to Florida Product Approval Rule 61G20-3.001.

Limits of Use:

- The Solar Attic Fan including solar panel and electrical wiring shall be installed in compliance with Attic Breeze's installation instructions and in accordance with applicable Building Codes
- Scope of "Limitations and Conditions of Use" for this evaluation:

This evaluation report for "Optional Statewide Approval" contains technical documentation, specifications and installation method(s) which include "Limitations and Conditions of Use" throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under "Optional Statewide Approval".

- Option for application outside "Limitations and Conditions of Use"
 Rule 61G20-3.005(1)(e) allows engineering analysis for "project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code". Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
- Refer to applicable building code section for ventilation requirements.
- Design of support system is outside the scope of this report.
- Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
- This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)

Quality Assurance:

The manufacturer has demonstrated compliance of roof vent products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Keystone Certification, Inc.** (FBC Organization #: QUA 1824)

CBUCK Engineering

FL #: FL 13339.3 R9 Date: 03 / 30 / 2021

Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 4 of 8

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Material Standards:

- Nominal Dimensions

Fan House Base: 28" × 28"

Fan House Shroud/ Dome: 21-1/2" × 21-1/2"

Overall Height: 10-3/4"

- Fan House Base & Shroud/Dome Material:

Material: Steel Thickness: 22 ga.

Yield Strength: 33 ksi Minimum

Corrosion Resistance: Galvalume or Zincalume per ASTM A792 AZ 50

or in compliance with the FBC, Section 1507.4.3.

Solar Panel: Various Sizes

Nominal Length: 38" maximum
Nominal Width: 22" maximum
Nominal Height: 2" maximum
Frame Material: Aluminum
Frame Alloy 5052-H32

Universal Mounting Bracket (One per Panel)

Material: Aluminum
Alloy: 5052-H32
Thickness: 0.090 in

Fastener (A) (Fan House Base to Roof Deck)

Type: Pancake Head Wood Screw

Size: # 10×1 in. Minimum

Standard: Per ANSI/ASME B18.6.1

Corrosion Resistance: Per FBC Section 1506.6

Fastener (B) (Panel to Bracket)

Type: Hex-Head Machine Bolts and Nuts Size 1/4 in. $-20 \times 3/4$ in. Minimum Washer: 1/4 in. Flat Washer & Lock Washer

Material: 18-8 Stainless Steel

Fastener (C) (Mounting Bracket to Dimensional Lumber)

Type: Hex-Head Lag Screw

Size 1/4 in. Embedment 1-1/2 in.

Standard: Per ANSI/ASME B18.6.1

Corrosion Resistance: Per FBC Section 1506.6 AND 1507.4.4



Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 5 of 8

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Installation:

Installation Method:

(Refer to Pages 6 through 8 of this evaluation report.)

"The Solar Attic Fans" shall be installed in compliance with the installation method listed in this report. The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Evaluated Referenced Data:

- ASTM E330-02 Uniform Static Air Pressure Difference Test
 By Certified Testing Laboratories, Inc. (FBC Organization ID# TST 1577)
 Project #: CTLA 2002W, Dated: 11 / 20 / 09
- 2. Quality Assurance

By Keystone Certification, Inc. (FBC Organization ID# QUA 1824) Attic Breeze, LLC. Licensee #740

- 3. Certification of Independence
 By James L. Buckner, P.E. @ CBUCK Engineering
 (FBC Organization # ANE 1916)
- 4. Engineering Analysis
 By CBUCK Engineering

Report #C09-194, Dated: 12 / 1 / 09 Report #C16-164, Dated: 10 / 20 / 16




Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 6 of 8


Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Solar Attic Fan Attachment Assembly

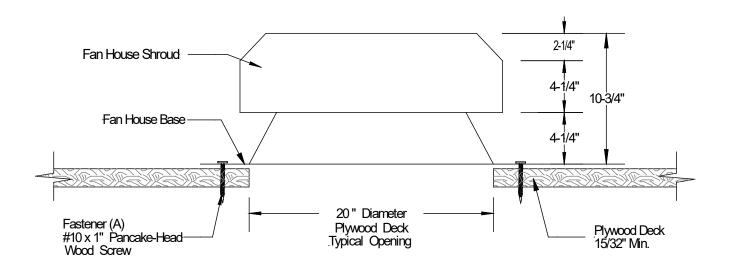

Assembly Front Section View

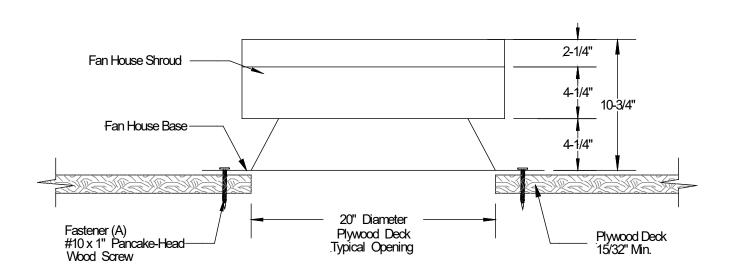

Assembly Side Section View

Installation Method Attic Breeze, LLC.




Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 7 of 8

Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Solar Attic Fan Attachment Assembly

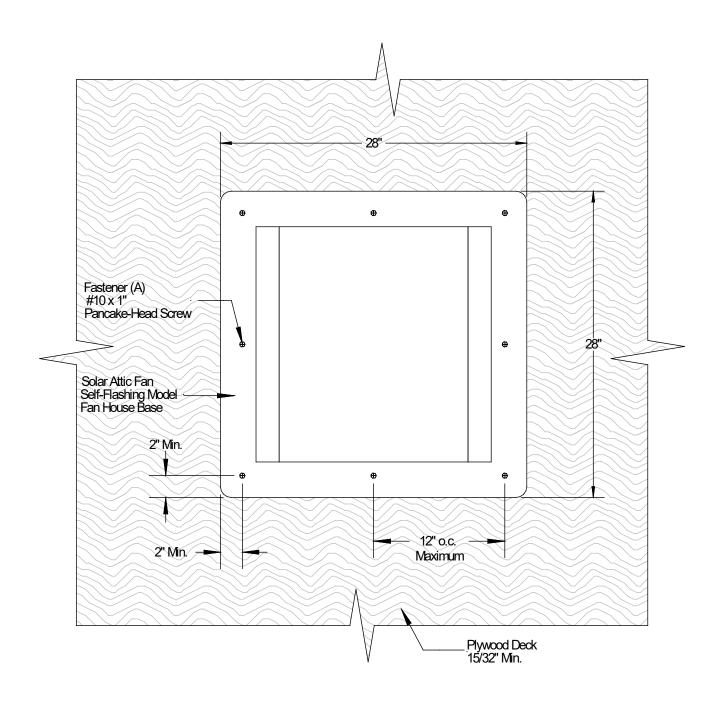

Assembly Top Plan View

Installation Method Attic Breeze, LLC.




Report No.: 21-416.03-SPAF-RemInc-S4W-ER

Page 8 of 8


Specialty Structural Engineering

CBUCK, Inc. Certificate of Authorization #8064

Inclined Remote Mounted Solar Panel Attached Assembly

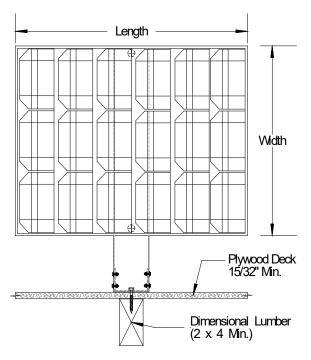

Front View

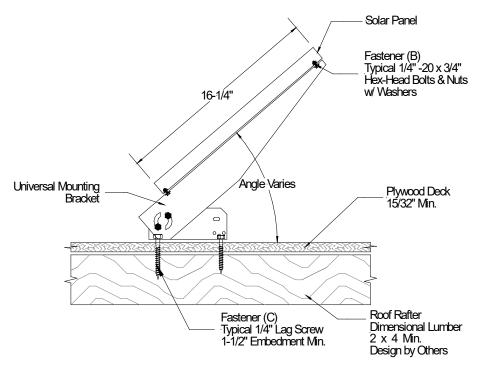

Section View & Attachment Detail